



Institute of Quality Management

Faizan Apartment 'B' Wing, S. V. Road, Jogeshwari (W), Mumbai - 400102
Tel. : 26795906, 26790217 Fax : 26799457 Email : ixarxamc@vsnl.net



Certificate No. IQM/05/1649

Date of Issue 22 SEP 2005

Certificate of Proficiency

Based on continue Performance
if the method, the certificate is
revalidated until 9/09/20

This is to certify that


S. SANGILIMUTHU

Has fulfilled the certification requirement and has demonstrated proficiency by
successfully qualifying the examination and is hereby

NDT level II

in

Radiographic Testing

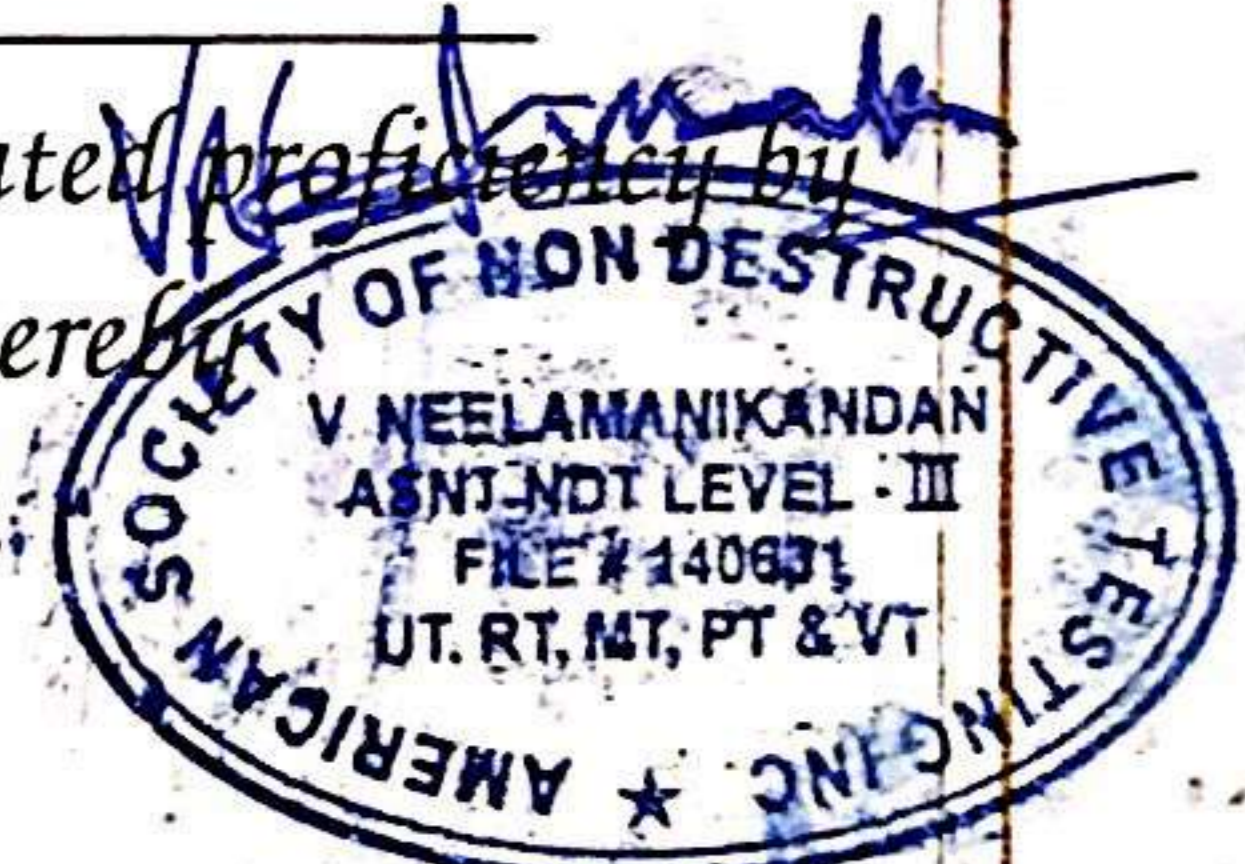

(Training course and examination for certification is as per
the recommendation of ASNT document SNT-TC-1A-2001 Edition)

This Certified ^{cate} is Re-Validated Upto 20 SEP 2014

A. C. Jaju
ASNT LEVEL - III
RT, UT, MT, PT.
I.D. NO 72834

| Paper | %Score |
|---------------|--------|
| General | 97.5 |
| Specific | 92.0 |
| Practical | 82.0 |
| Average Score | 90.5 |

This Certified ^{cate} is Re-Validated Upto 20 SEP 2011

A. C. Jaju
ASNT LEVEL - III
KT, UT, MT, PT.
I.D. NO 72834

This certificate is valid for a period of three years.

Anil V. Jain
Chairman



RENEWED BASED ON
CONTINUED SATISFACTORY
PERFORMANCE AND EYE TEST
VALID UPTO 20/09/2017

C. Kumar Candidate

JAS-ANZ



Institute of Quality Management

Faizan Apartment 'B' Wing, S. V. Road, Jogeshwari (W), Mumbai - 400102
Tel. : 26795906, 26790217 Fax : 26799457 Email : ixarxamc@mtnl.net.in



Certificate No. IQM/10/R2190

Date of Issue 19 FEB 2010

Certificate of Proficiency


This is to certify that

S. SANGILIMUTHU

Has fulfilled the certification requirement and has demonstrated proficiency by successfully qualifying the examination and is hereby certified to

NDT LEVEL II
in
ULTRASONIC TESTING


BASED ON EXPERIENCES
CONTINUOUS PERFORMANCE
RENEWED UPTO 15-02-2024



Ammy Dever

(Training course and examination for certification is as per the recommendation of ASNT document SNT-TC-1A-2006 Edition)

This certificate is Re-validated upto 16 Feb., 2019.

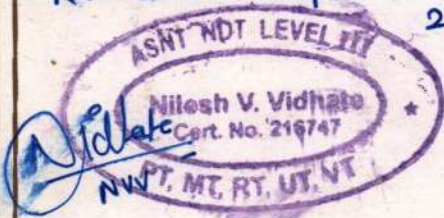

| Paper | %Score |
|---------------|--------|
| General | 75.0 |
| Specific | 85.0 |
| Practical | 80.0 |
| Average Score | 80.0 |

This Certified is Re-Validated Upto **17 FEB 2016**

A. C. Jaju
ASNT LEVEL - III
RT, UT, MT, PT,
I.D. NO 72834

A. C. Jaju

This certificate is valid for a period of three years.

Anil V. Jain

Anil V. Jain
Chairman



Course Director
ASNT Level III

S. Sangilimuthu

Candidate

Institute of Quality Management

Faizan Apartment 'B' Wing, S. V. Road, Jogeshwari (W), Mumbai - 400102
 Tel. : 26795906, 26790217 Fax : 26799457 Email : ixarxamc@vsnl.net



Certificate No. IQM/05/1675

Date of Issue 06 OCT 2005

Certificate of Proficiency

Based on continue Performance in the method, the certificate is revalidated until 03/12/20

This is to certify that


S. SANGILIMUTHU

Has fulfilled the certification requirement and has demonstrated proficiency by successfully qualifying the examination and is hereby

NDT level II

in

Magnetic Particle Testing

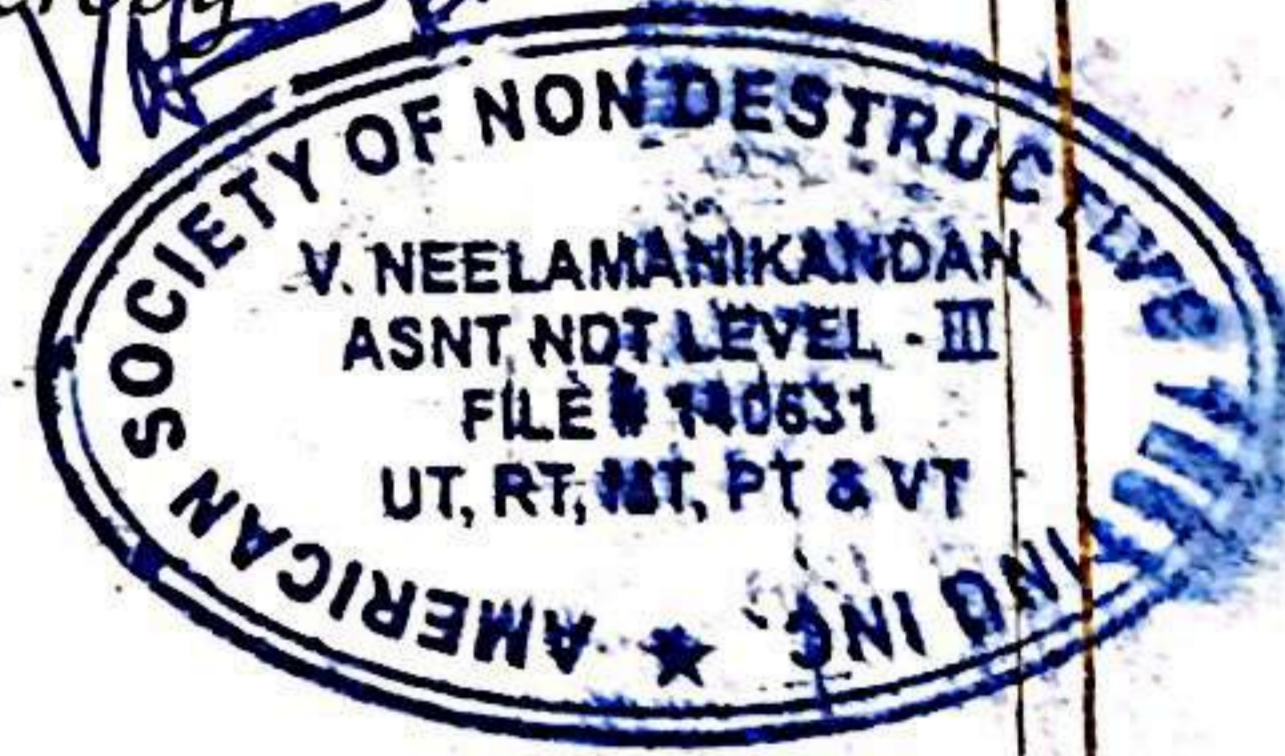

(Training course and examination for certification is as per the recommendation of ASNT document SNT-TC-1A-2001 Edition)

This Certified is Re-Validated Upto 04 OCT 2014
 A. C. Jaju
 ASNT LEVEL - III
 RT, UT, MT, PT.
 I.D. NO 72834

| Paper | %Score |
|---------------|--------|
| General | 92.5 |
| Specific | 95.0 |
| Practical | 80.0 |
| Average Score | 89.2 |

This Certified is Re-Validated Upto 04 OCT 2011
 A. C. Jaju
 ASNT LEVEL - III
 KT, UT, MT, PT.
 I.D. NO 72834

This certificate is valid for a period of three years.

Adm
 Anil V. Jain
 Chairman

ASNT LEVEL III
 AC JAJU
 ID NO 72834
 Course Director
 ASNT Level III


RENEWED BASED ON CONTINUED SATISFACTORY PERFORMANCE AND EYE TEST VALID UPTO 20/09/2007



Samu
 Candidate



Institute of Quality Management

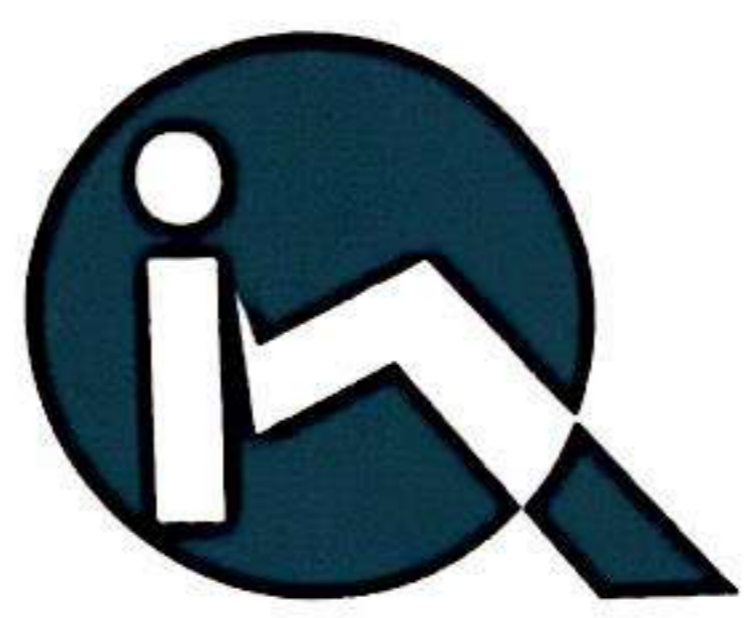

Certificate No. IQM/05/1669

Date of Issue 01 OCT 2005

Certificate of Proficiency

Based on continue Performance in the method, the certificate is revalidated until 28/09/20

This is to certify that

S. SANGILIMUTHU

has fulfilled the certification requirements and has demonstrated proficiency by successfully qualifying the examination,

certified to
NDT Level II

in

Liquid Penetrant Testing

(Training course and examination for certification is as per the recommendations of ASNT document SNT-TC-1A - 2001 Edition)



This Certified is Re-Validated Upto 29 SEP 2014

A. C. Jaju
ASNT LEVEL - III
RT, UT, MT, PT,
I.D. NO 72834

| Paper | % Score |
|---------------|-------------|
| General | <u>95.0</u> |
| Specific | <u>80.0</u> |
| Practical | <u>82.0</u> |
| Average Score | <u>85.7</u> |

This Certified is Re-Validated Upto 29 SEP 2011

A. C. Jaju
ASNT LEVEL - III
KT, UT, MT, PT,
I.D. NO 72834

This certificate is valid for a period of three years.

RENEWED BASED ON CONTINUED SATISFACTORY PERFORMANCE AND EYE TEST VALID UPTO 20/09/2017

Anil V. Jain
Chairman



Course Director
ASNT Level III

Candidate

